TEST REPORT

JANOSHIK

E-mail: info@janoshik.com
Web: www.janoshik.com

Task Number #157451

Testing ordered > 10 MAY '26

Sample received > 28 MAY '26

Client	ELYVERA
Sample	Triple Receptor Agonist 50mg
Manufacturer	Distributed by ELYVERA
Batch	TRA-50-2026-001

Sample description >

See picture or pictures attached.

Tests requested >

Common GLP-1 peptide blind test (Semaglutide, Tirzepatide and Retatrutide)

Results >

Retatrutide	54.69 mg
Purity	99.800%

Comments >

Analysis conducted > 05 JUN 2026

Signature >



Verify this test at www.janoshik.com/verify/ with the following unique key

H6RYBK6VG3RA

TEST REPORT

JANOSHIK

E-mail: info@janoshik.com
Web: www.janoshik.com

Task Number #157457

Testing ordered > 10 MAY '26

Sample received > 28 MAY '26

Client	ELYVERA
Sample	Triple Receptor Agonist 50mg
Manufacturer	Distributed by ELYVERA
Batch	TRA-50-2026-001

Sample description >

See picture or pictures attached.

Tests requested >

Heavy Metals Analysis

Results >

As	not detected.
Cd	not detected.
Pb	not detected.

Comments >

Hg: not detected. Although the raw data show low ppm values for heavy metals, these do not necessarily indicate true detection. As shown in the attached graphs, the signals are consistent with electronic noise inherent to the detection system; therefore, the results were concluded as “not detected”.

Analysis conducted > 03 JUN 2026

Signature >

Verify this test at www.janoshik.com/verify/ with the following unique key

SBDMDWLHJKEU

TEST REPORT

JANOSHIK

E-mail: info@janoshik.com
Web: www.janoshik.com

Task Number #157455

Testing ordered > 10 MAY '26

Sample received > 28 MAY '26

Client	ELYVERA
Sample	Triple Receptor Agonist 50mg
Manufacturer	Distributed by ELYVERA
Batch	TRA-50-2026-001

Sample description >

See picture or pictures attached.

Tests requested >

LCMS Screening For Peptide Contamination

Results >

LCMS screening	

Comments >

LCMS analysis identified the presence of mannitol, retatrutide, and degradation products.
LCMS spectra are attached. No significant contamination detected.

Analysis conducted > 05 JUN 2026

Signature >

Verify this test at www.janoshik.com/verify/ with the following unique key

QWRLR1WEXI8C

TEST REPORT

JANOSHIK

E-mail: info@janoshik.com
Web: www.janoshik.com

Task Number #157452

Testing ordered > 10 MAY '26

Sample received > 28 MAY '26

Client	ELYVERA
Sample	Triple Receptor Agonist 50mg
Manufacturer	Distributed by ELYVERA
Batch	TRA-50-2026-001

Sample description >

See picture or pictures attached.

Tests requested >

TFA analysis

Results >

TFA	not detected

Comments >

Analysis conducted > 05 JUN 2026

Signature >



Verify this test at www.janoshik.com/verify/ with the following unique key

LKVDBC15JNIZ

TEST REPORT

JANOSHIK

E-mail: info@janoshik.com
Web: www.janoshik.com

Task Number #157453

Testing ordered > 10 MAY '26

Sample received > 28 MAY '26

Client ELYVERA

Sample Triple Receptor Agonist 50mg

Manufacturer Distributed by ELYVERA

Batch TRA-50-2026-001

Sample description >

See picture or pictures attached.

Tests requested >

pH Measurement

Results >

pH	7.66

Comments >

Analysis conducted > 09 JUN 2026

Signature >

Verify this test at www.janoshik.com/verify/ with the following unique key

MR6PSMUN7D2Q

TEST REPORT

JANOSHIK

E-mail: info@janoshik.com
Web: www.janoshik.com

Task Number #157454

Testing ordered > 10 MAY '26

Sample received > 28 MAY '26

Client	ELYVERA
Sample	Triple Receptor Agonist 50mg
Manufacturer	Distributed by ELYVERA
Batch	TRA-50-2026-001

Sample description >

See picture or pictures attached.

Tests requested >

Endotoxin Analysis

Results >

Endotoxin	2.037 EU/Vial.

Comments >

Analysis conducted > 02 JUN 2026

Signature >



Verify this test at www.janoshik.com/verify/ with the following unique key

R2FLKP2SDVXM

TEST REPORT

JANOSHIK

E-mail: info@janoshik.com
Web: www.janoshik.com

Task Number #157456

Testing ordered > 10 MAY '26

Sample received > 28 MAY '26

Client	ELYVERA
Sample	Triple Receptor Agonist 50mg
Manufacturer	Distributed by ELYVERA
Batch	TRA-50-2026-001

Sample description >

See picture or pictures attached.

Tests requested >

Sterility Testing

Results >

TAMC	PASS
TYMC	PASS

Comments >

Analysis conducted > 16 JUN 2026

Signature >



Verify this test at www.janoshik.com/verify/ with the following unique key

GYM66UIBNF4Y

JANOSHIK



JANOSHIK


SHIMADZU LabSolutions

Analysis Report

<Sample Information>

Sample Name	: 21137-2 Reta 50mg		
Sample ID	: 053		
Data Filename	: 21137-2 Reta 50mg _017.lcd		
Method Filename	: C18- GLP1.lcm		
Batch Filename	: 03_06_2026_01.lcb		
Vial #	: 2-53	Sample Type	: Unknown
Injection Volume	: 0.5 uL		
Date Acquired	: 03.06.2026 16:50:17	Acquired by	: System Administrator
Date Processed	: 03.06.2026 16:56:20	Processed by	: System Administrator

<Chromatogram>

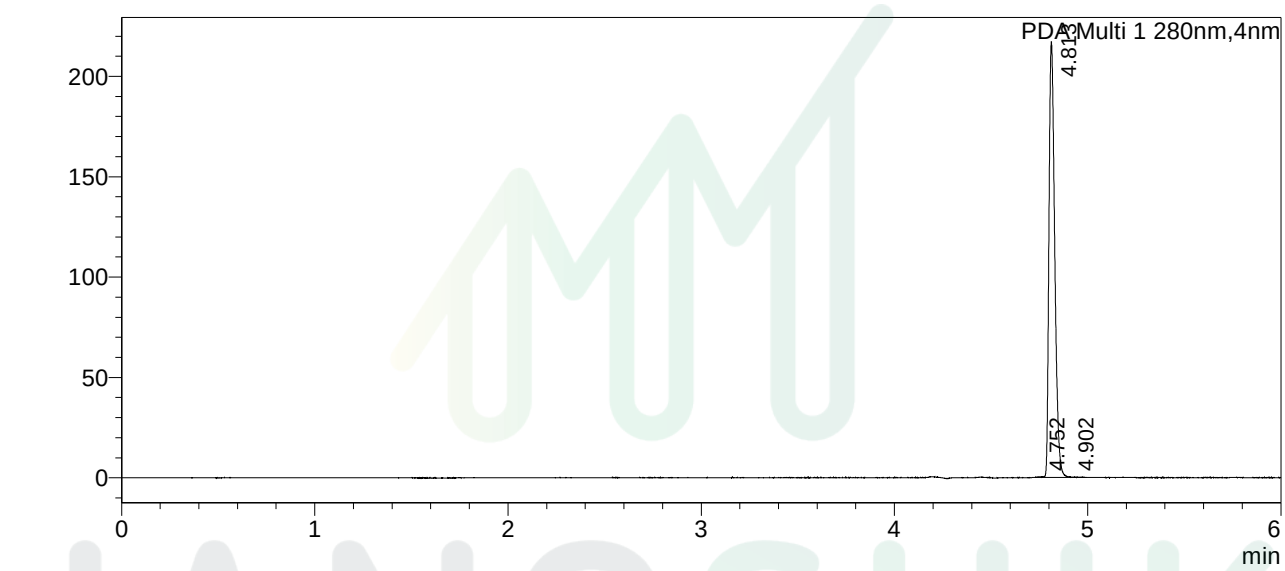

<Peak Table>

PDA Ch1 280nm


Peak#	Ret. Time	Area	Conc.	Unit	Name	Area%
1	4.752	429	0.00			0.095
2	4.813	452601	54.69	mg	Retatrutide	99.800
3	4.902	479	0.00			0.106
Total		453509				100.000

Sample : 21137-2
Operator: MB
Comment : Comment
Group : As_test
Date : 2026-06-03 08:50:00

Measurement Condition

Instrument: EDX-7000	Atmosphere: Air	Collimator: 10(mm)	Sample Cup:Polypropylene

Analyte	TG	kV	uA	FI	Acq.(keV)	Anal.(keV)	Time(sec)	DT(%)
As	Rh	50	18-Auto	----	0 - 40	10.30-10.80	Live- 50	30

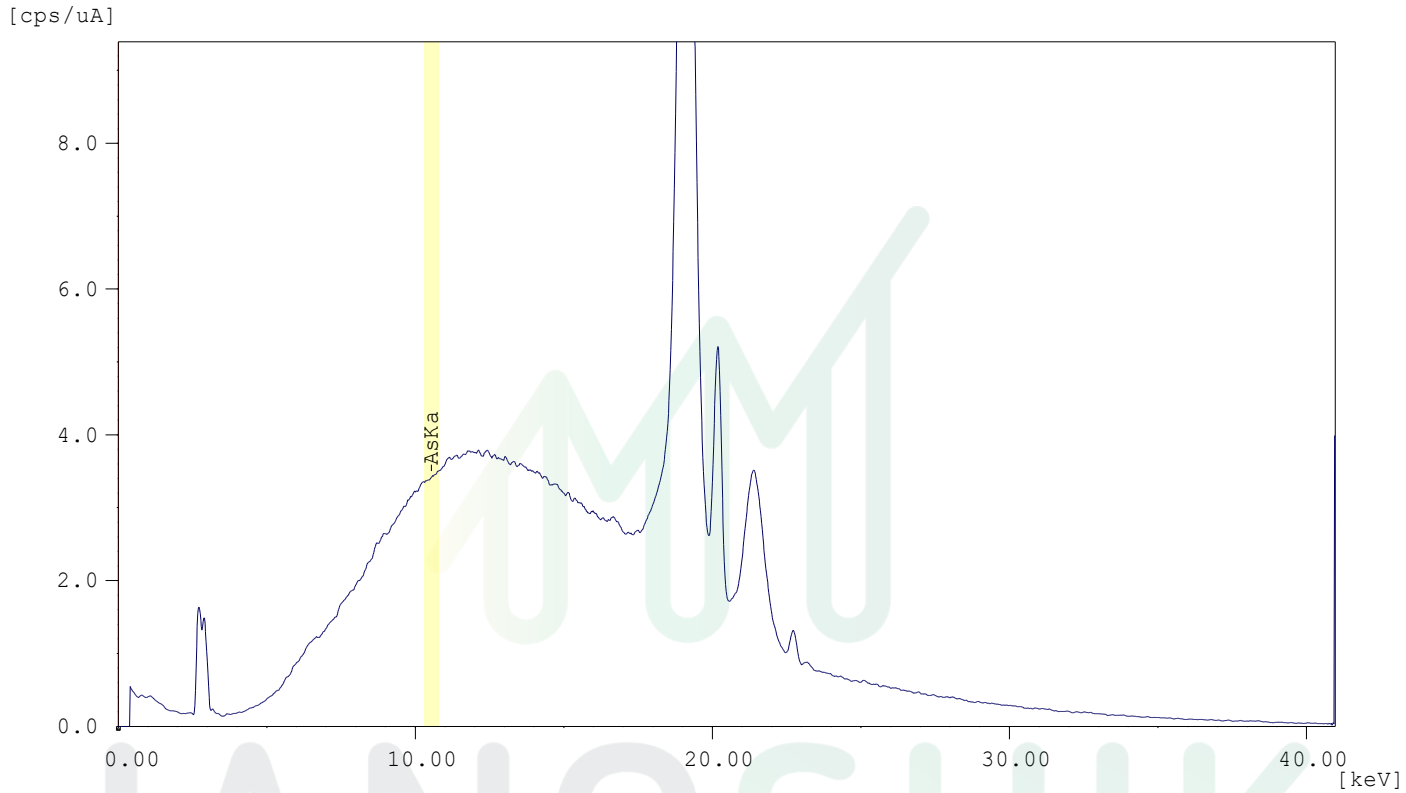

Peak List

Channel	Line	keV	Net Int.(cps/uA)	
As	AsKa	10.54	0.0181	Q

Quantitative Result

Analyte	Result	[3-sigma]	Proc.-Calc.	Line	Int.(cps/uA)
As	0.1 ppm	L [4.0]	Quan-EC	AsKa	0.0181

Sample : 21137-2
Operator: MB
Comment : Comment
Group : Hg_Pb_Cd
Date : 2026-06-03 08:27:28

Measurement Condition

Instrument: EDX-7000 Atmosphere: Air Collimator: 10(mm) Sample Cup:Polypropylene

Analyte	TG kV	uA	FI	Acq.(keV)	Anal.(keV)	Time(sec)	DT(%)
Cd	Rh 50	673-Auto	#5	0 - 40	22.72-23.52	Live- 51	30
Hg	Rh 50	673-Auto	#5	0 - 40	9.74-10.24	Live- 51	30
Pb	Rh 50	673-Auto	#5	0 - 40	12.38-12.88	Live- 51	30

Qualitative Result

Element: Cd, Hg, Pb

Peak List


Channel	Line	keV	Net Int.(cps/uA)	
Cd	CdKa	23.12	0.0026	Q
Hg	HgLa	9.98	0.0000	Q
Pb	PbLb1	12.62	0.0002	Q

Quantitative Result

Analyte	Result		[3-sigma]	Proc.-Calc.	Line	Int.(cps/uA)
Cd	5.0 ppm	L	[3.3]	Quan-EC	CdKa	0.0026
Hg	0.2 ppm	L	[1.2]	Quan-EC	HgLa	0.0000
Pb	2.8 ppm	L	[4.3]	Quan-EC	PbLb1	0.0002

JANOSHIK


Sample : 21137-2 Group : Hg_Pb_Cd Date : 2026-06-03 08:27:28
Operator: MB Comment : Comment 01/01

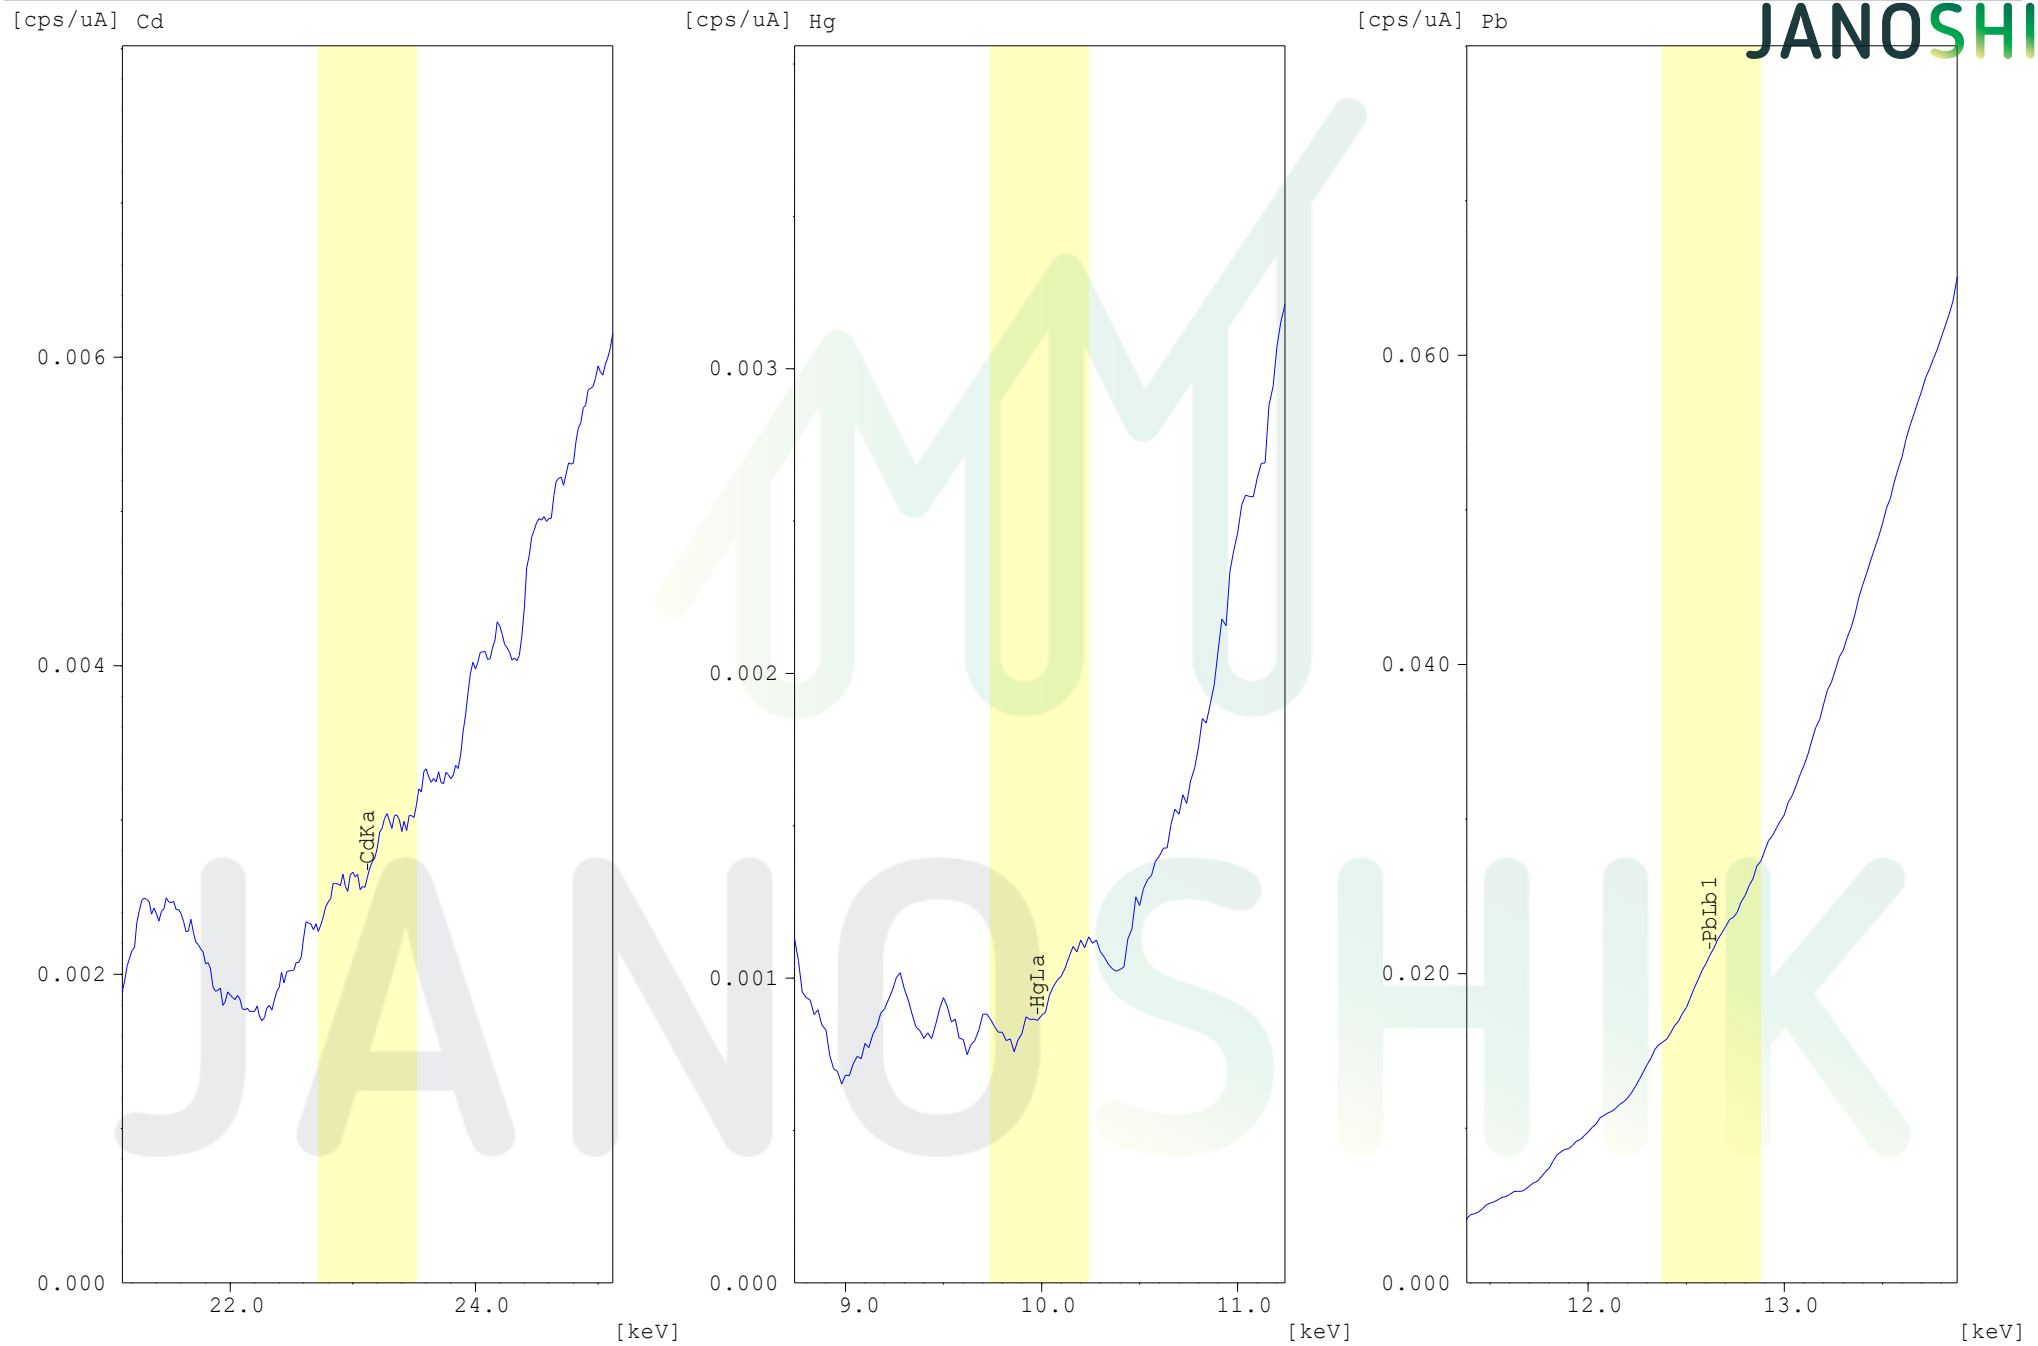

==== Shimadzu LabSolutions Data Report ====

<Spectrum>

Line#:1 R.Time:0.258(Scan#:121)
MassPeaks:66
RawMode:Single 0.258(121) BasePeak:205(8185713)
BG Mode:None Segment 1 - Event 1

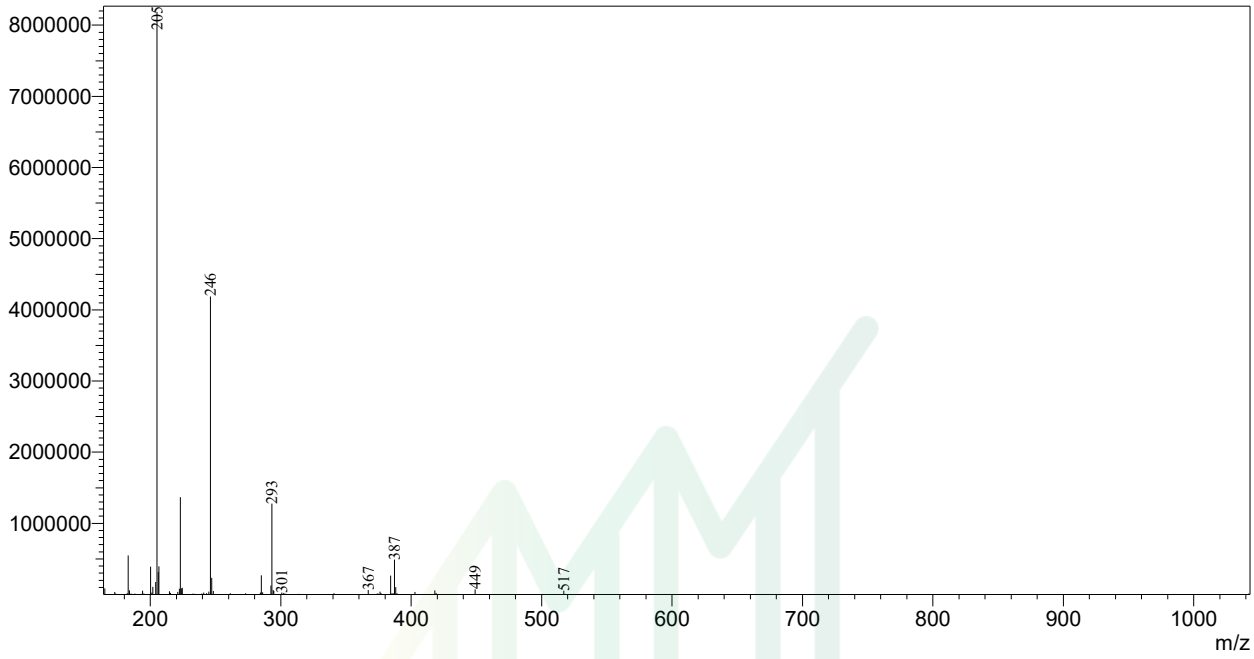


JANOSHIK

==== Shimadzu LabSolutions Data Report ====

<Spectrum>

Line#:1 R.Time:2.302(Scan#:1072)
MassPeaks:86
RawMode:Single 2.302(1072) BasePeak:1578(3745375)
BG Mode:None Segment 1 - Event 1

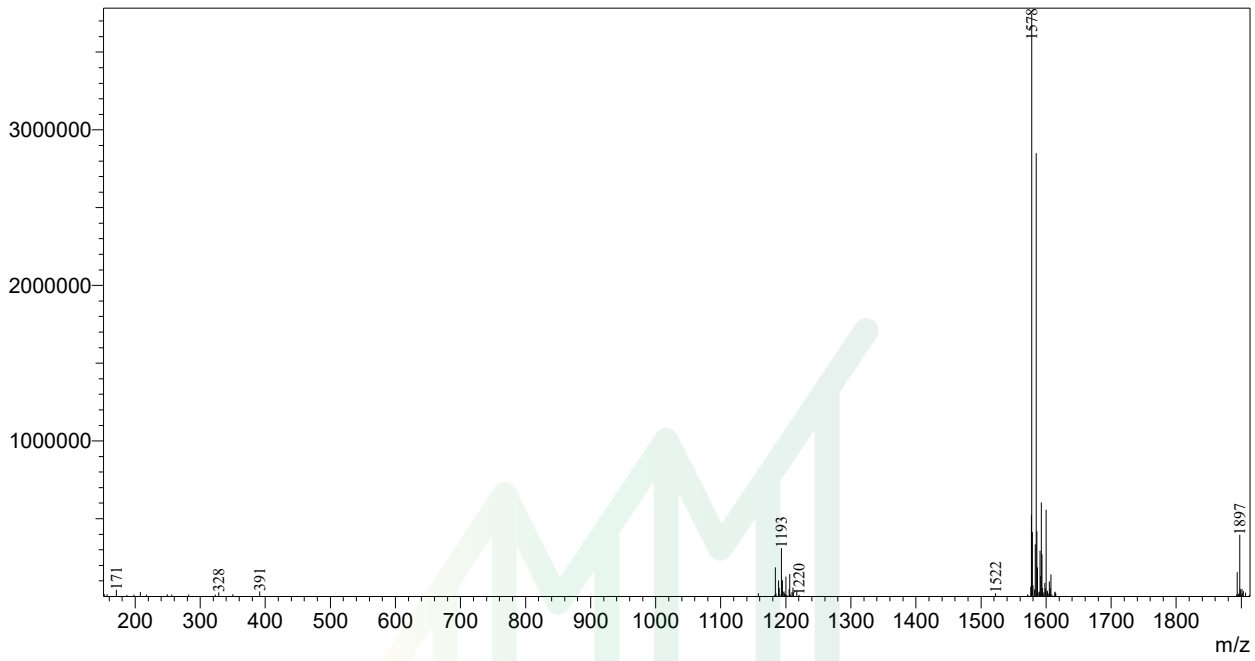


JANOSHIK

==== Shimadzu LabSolutions Data Report ====

<Spectrum>


Line#:1 R.Time:2.517(Scan#:1172)
MassPeaks:77
RawMode:Single 2.517(1172) BasePeak:1578(1447090)
BG Mode:None Segment 1 - Event 1

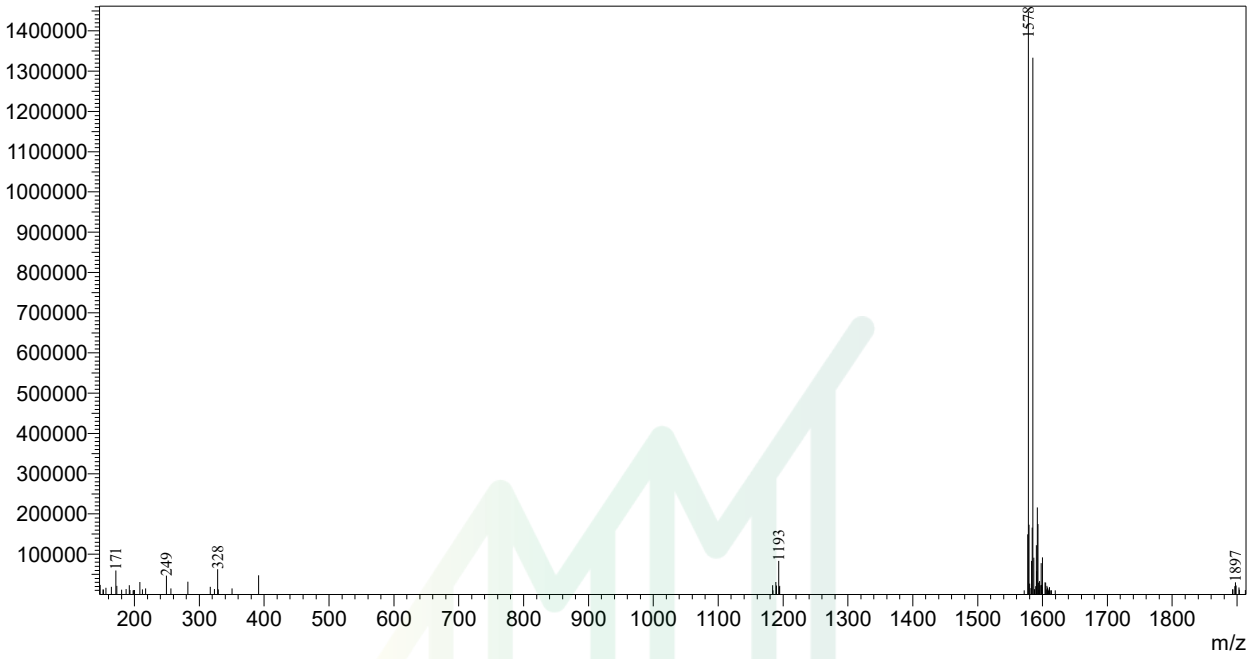

JANOSHIK

==== Shimadzu LabSolutions Data Report ====

<Chromatogram>

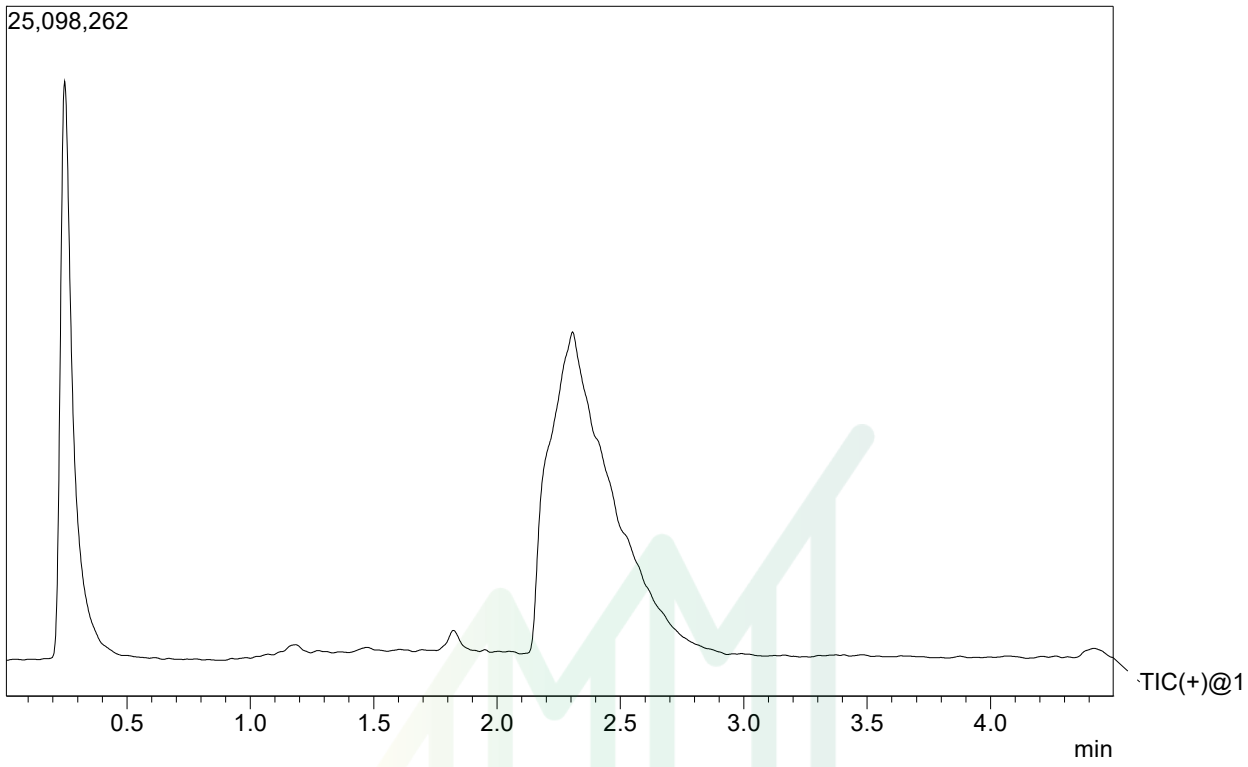

JANOSHIK

METTLER TOLEDO

